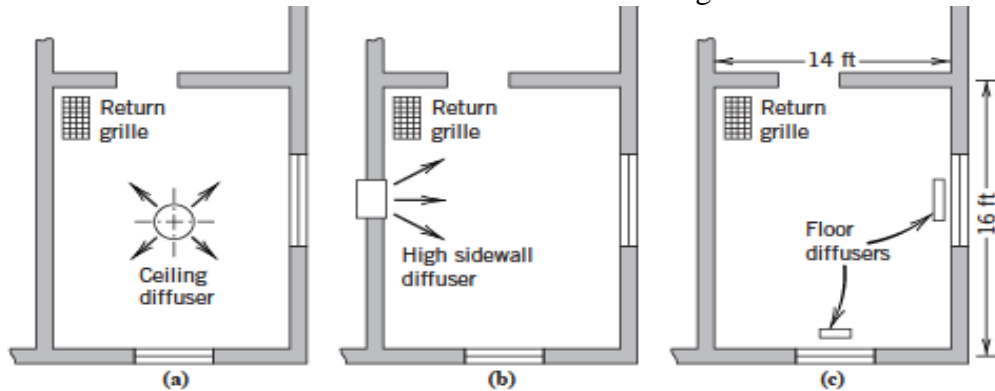


## Lecture -6-

The general procedure for use of Table 11-2 is as follows:

1. Determine the air-flow requirements and the room size.
2. Select the number, location, and type of diffuser to be used.
3. Determine the room characteristic length.
4. Select the recommended throw-to-length ratio from Table 11-2.
5. Calculate the throw.
6. Select the appropriate diffuser from catalog data such as those in Tables 11-3, 11-4, 11-5, or 11-6.
7. Make sure any other specifications are met (noise, total pressure, etc.).

Ex: The room shown in Figure (1) is part of a single-story office building located in the central United States. A perimeter air-distribution system is used. The air quantity required for the room is **250 cfm**. Select diffusers for the room based on cooling.



**Figure 1** Plan view of a room showing location of different types of outlets.

Solution:.

Diffusers of the type shown in **Table 11-3** should be used for this application.

A diffuser should be placed under each window in the floor near the wall (Figure c) because the room has two exposed walls. This will promote mixing with the warm air entering through the window. The total air quantity is **divided equally** between the two diffusers ( $250/2=125$  cfm). If we assume that the room has an 8 ft ceiling and a room cooling load of 40 Btu/(hr-ft<sup>2</sup>), **the room characteristic length is 8 ft (16/2)**.

**Table 11-2** gives a **throw-to-length ratio of 1.3** for a straight vane diffuser. Then

$$\frac{x50}{L} = 1.3 \rightarrow \frac{x50}{8} = 1.3 \rightarrow \underline{x50 = 10.4 \text{ ft}} \text{ (throw=blow)}$$

From **Table 11-3**, a **4 × 12 in.** diffuser with **125 cfm** has a throw (blow), corrected for length, between

$$x50 = 13\left(\frac{3}{4}\right) = 9.7 \text{ ft} \text{ and } x50 = 17\left(\frac{3}{4}\right) = 12.7 \text{ ft}$$

because 125 cfm lies between 111 cfm and 139 cfm.

The NC is quite acceptable and is between **12 and 18**, uncorrected for length. The total pressure required by the diffuser is between 0.036 and 0.057 in. wg and is about

$$\Delta P = (125/111)^2 \times (0.036) = \underline{0.046 \text{ in. wg}}$$

**An acceptable solution is listed as follows:**

Size, in.	Capacity, cfm	Throw, ft	NC	$\Delta P_0$ , in. wg
4 × 12	125	10.5	<15	0.046

**The loss in total pressure for the diffuser is an important consideration. The value shown above would be acceptable for a light commercial system.**

**Table 11-1 Characteristic Room Length for Several Diffusers**

Diffuser Type	Characteristic Length $L$
High sidewall grille	Distance to wall perpendicular to jet
Circular ceiling diffuser	Distance to closet wall or intersecting air jet
Sill grille	Length of room in direction of jet flow
Ceiling slot diffuser	Distance to wall or midplane between outlets
Light troffer diffusers	Distance to midplane between outlets plus distance from ceiling to top of occupied zone
Perforated, louvered ceiling diffusers	Distance to wall or midplane between outlets

Source: Reprinted by permission from *ASHRAE Handbook, Fundamentals Volume*, 1997.

**Table 11-2 Air Diffusion Performance Index (ADPI) Selection Guide**

Terminal Device	Room Load, Btu/hr-ft <sup>2</sup>	$x_{50}/L^a$ for Maximum ADPI	Maximum ADPI	For ADPI Greater Than	Range of $x_{50}/L^a$
High sidewall grilles	80 (252)	1.8	68	—	—
	60 (189)	1.8	72	70	1.5–2.2
	40 (126)	1.6	78	70	1.2–2.3
	20 (63)	1.5	85	80	1.0–1.9
Circular ceiling diffusers	80 (252)	0.8	76	70	0.7–1.3
	60 (189)	0.8	83	80	0.7–1.2
	40 (126)	0.8	88	80	0.5–1.5
	20 (63)	0.8	93	90	0.7–1.3
Sill grille, Straight vanes	80 (252)	1.7	61	60	1.5–1.7
	60 (189)	1.7	72	70	1.4–1.7
	40 (126)	1.3	86	80	1.2–1.8
	20 (63)	0.9	95	90	0.8–1.3
Sill grille, Spread vanes	80 (252)	0.7	94	90	0.6–1.5
	60 (189)	0.7	94	80	0.6–1.7
	40 (126)	0.7	94	—	—
	20 (63)	0.7	94	—	—
Ceiling slot diffusers (for $T_{100}/L$ ) <sup>a</sup>	80 (252)	0.3	85	80	0.3–0.7
	60 (189)	0.3	88	80	0.3–0.8
	40 (126)	0.3	91	80	0.3–1.1
	20 (63)	0.3	92	80	0.3–1.5
Light troffer diffusers	60 (189)	2.5	86	80	<3.8
	40 (126)	1.0	92	90	<3.0
	20 (63)	1.0	95	90	<4.5
Perforated and louvered ceiling diffusers	11–51 (35–160)	2.0	96	90	1.4–2.7
				80	1.0–3.4

<sup>a</sup>For SI units,  $x_{0.25}/L$  and  $T_{0.5}/L$

Source: Reprinted by permission from *ASHRAE Handbook, Fundamentals Volume*, 1997.


**Table 11-3 Performance Data for a Typical Linear Diffuser**

Size, in.	Area, ft <sup>2</sup> /ft	Total Pressure, in. wg	Flow, cfm/ft	NC <sup>b</sup>	Throw, <sup>a</sup> ft		
					Min.	Mid.	Max.
2	0.055	0.009	22	—	1	1	1
		0.020	33	—	4	4	4
		0.036	44	12	7	7	7
		0.057	55	18	9	9	10
		0.080	66	23	11	11	12
		0.109	77	27	13	14	16
		0.143	88	31	14	16	18
		0.182	99	34	15	17	20
		0.225	110	37	17	19	21
4	0.139	0.009	56	—	3	3	3
		0.020	83	—	9	9	9
		0.036	111	12	13	13	13
		0.057	139	18	16	16	17
		0.080	167	23	20	20	21
		0.109	195	27	22	23	24
		0.143	222	31	24	25	26
		0.182	250	34	27	27	27
		0.225	278	37	30	30	30
6	0.221	0.009	88	—	5	5	5
		0.020	133	—	10	10	10
		0.036	177	13	15	15	15
		0.057	221	19	18	18	18
		0.080	265	24	23	23	23
		0.109	310	28	25	25	25
		0.143	354	32	28	28	28
		0.182	398	35	31	31	31
		0.225	442	38	32	32	32

Active Length, ft	Multiplier Factor for Throw Value at Terminal Velocity, ft/min		
	150	100	50
1	0.5	0.6	0.7
10 or continuous	1.6	1.4	1.2

Active Length, ft	NC Correction	Active Length, ft	NC Correction
1	-10	10	0
2	-7	15	+2
4	-4	20	+3
6	-2	25	+4
8	-1	30	+5

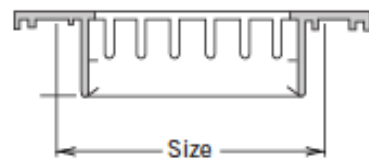

<sup>a</sup>Minimum throw values refer to a terminal velocity of 150 ft/min, middle to 100 ft/min, and maximum to 50 ft/min, for a 4 ft active section with a cooling temperature differential of 20 F. The multiplier factors listed at the bottom are applicable for other lengths.

<sup>b</sup>Based on a room absorption of 80 dB referred to 10<sup>-12</sup> W, and a 10 ft active section.

Source: Reprinted by permission of Environmental Elements Corporation, Dallas, TX.

**Table 11-4 Performance Data for a Typical Round Ceiling Diffuser**

Size, in.	Neck Velocity, ft/min	Velocity Pressure, in. wg	Total Pressure, in. wg	Flow Rate, cfm	Radius of Diffusion, <sup>a</sup> ft			NC <sup>b</sup>
					Min	Mid	Max	
6	400	0.010	0.026	80	2	2	4	—
	500	0.016	0.041	100	2	3	5	—
	600	0.023	0.059	120	2	4	6	14
	700	0.031	0.079	140	3	4	7	19
	800	0.040	0.102	160	3	5	8	23
	900	0.051	0.130	180	4	5	9	26
	1000	0.063	0.161	200	4	6	10	30
	1200	0.090	0.230	235	5	7	11	35
8	400	0.010	0.033	140	2	4	6	—
	500	0.016	0.052	175	3	4	7	15
	600	0.023	0.075	210	4	5	9	21
	700	0.031	0.101	245	4	6	10	26
	800	0.040	0.130	280	5	7	11	31
	900	0.051	0.166	315	5	8	13	34
	1000	0.063	0.205	350	6	9	14	37
	1200	0.090	0.292	420	7	11	17	44
10	400	0.010	0.027	220	3	4	7	—
	500	0.016	0.043	270	3	5	8	11
	600	0.023	0.062	330	4	6	10	17
	700	0.031	0.084	380	5	7	11	21
	800	0.040	0.108	435	5	8	13	26
	900	0.051	0.138	490	6	9	15	30
	1000	0.063	0.170	545	7	10	16	33
	1200	0.090	0.243	655	8	12	20	39
12	400	0.010	0.026	315	3	5	8	—
	500	0.016	0.042	390	4	6	10	11
	600	0.023	0.060	470	5	7	12	17
	700	0.031	0.081	550	6	8	13	22
	800	0.040	0.105	630	6	10	15	26
	900	0.051	0.134	705	7	11	17	30
	1000	0.063	0.166	785	8	12	19	33
	1200	0.090	0.236	940	10	14	23	39
18	400	0.010	0.030	710	5	7	12	—
	500	0.016	0.048	885	6	9	15	15
	600	0.023	0.069	1060	7	11	18	21
	700	0.031	0.093	1240	9	13	21	26
	800	0.040	0.120	1420	10	15	24	30
	900	0.051	0.153	1590	11	17	27	34
	1000	0.063	0.189	1770	12	19	30	37
	1200	0.090	0.270	2120	15	22	36	43

**Table 11-4 Performance Data for a Typical Round Ceiling Diffuser (continued)**

Size A	Dimensions			
	B	C	D	E
6	6 1/2	11 1/8	1 3/4	1 1/8
8	8 1/2	14 3/4	2 1/8	1 1/2
10	10 1/2	18 1/4	2 7/8	2 1/8
12	12 1/2	22	3 1/8	2 3/8
24	24 1/2	43 1/4	7 3/4	6 5/8

The diagram illustrates a cross-section of a round ceiling diffuser. It shows a duct with diameter 'A' and a diffuser with diameter 'B'. The total diameter of the diffuser is 'C'. The distance from the center of the duct to the edge of the diffuser is 'D'. The distance from the center of the duct to the ceiling is 'E'. The diffuser is shown in two states: 'Open' (with a gap of 3/4 inch) and 'Closed'. A gasket is shown between the diffuser and the ceiling.

<sup>a</sup>Minimum radii of diffusion are to a terminal velocity of 150 ft/min, middle to 100 ft/min, and maximum to 50 ft/min.

<sup>b</sup>The NC values are based on a room absorption of 18 dB referred to 10<sup>-13</sup> W (8 dB referred to 10<sup>-12</sup> W).

Source: Reprinted by permission of Environmental Elements Corporation, Dallas, TX.

**Table 11-5 Performance Data for an Adjustable-Type, High Sidewall Diffuser**

Sizes, in.	$A_v$ , ft <sup>2</sup>	Flow, Rate, cfm	Veloc., ft/min	Veloc. Press., in. wg	Total Pressure, in. wg			NC	Defl., deg	Throw, ft		
					0°	22½°	45°			Min.	Mid.	Max.
8 × 4	0.18	70	400	0.010	0.017	0.019	0.029	—	0	6	8	15
7 × 5,									22½	5	6	12
6 × 6									45	3	4	8
10 × 4,	0.22	90						—	0	7	10	17
8 × 5,									22½	6	8	14
7 × 6									45	3	5	9
12 × 4,	0.26	105						—	0	7	11	19
10 × 5,									22½	6	9	15
8 × 6									45	4	5	9
16 × 4,	0.34	135						—	0	8	12	21
12 × 5,									22½	6	10	17
10 × 6									45	4	6	11
18 × 4,	0.39	155						—	0	9	13	23
14 × 5,									22½	7	10	18
12 × 6,									45	4	6	11
8 × 4,	0.18	90	500	0.016	0.028	0.031	0.047	—	0	7	11	17
7 × 5,									22½	6	9	14
6 × 6									45	4	5	9
10 × 4,	0.22	110						—	0	8	12	19
8 × 5,									22½	6	10	15
7 × 6									45	4	6	10
12 × 4,	0.26	130						—	0	9	13	21
10 × 5,									22½	7	10	17
8 × 6									45	4	7	10
16 × 4,	0.34	170						—	0	10	15	24
12 × 5,									22½	8	12	19
10 × 6									45	5	8	11
18 × 4,	0.39	195						—	0	11	16	25
14 × 5,									22½	9	13	20
12 × 6,									45	5	8	13


*continues*

**Table 11-5 Performance Data for an Adjustable-Type, High Sidewall Diffuser (continued)**

Sizes, in.	$A_s$ , ft <sup>2</sup>	Flow, Rate, cfm	Veloc., ft/min	Veloc. Press., in. wg	Total Pressure, in. wg			NC	Defl., deg	Throw, ft		
					0°	22½°	45°			Min.	Mid.	Max.
8 × 4, 7 × 5, 6 × 6	0.18	110	600	0.022	0.038	0.043	0.064	10	0 22½ 45	9 7 4	13 10 7	19 15 10
10 × 4, 8 × 5, 7 × 6	0.22	130						10	0 22½ 45	9 7 5	15 12 7	21 17 10
12 × 4, 10 × 5, 8 × 6	0.26	155						11	0 22½ 45	10 8 5	16 13 8	23 18 11
16 × 4, 12 × 5, 10 × 6	0.34	205						12	0 22½ 45	12 10 6	19 15 9	26 21 13
18 × 4, 14 × 5, 12 × 6	0.39	235						13	0 22½ 45	13 10 7	19 15 10	28 22 14
8 × 4, 7 × 5, 6 × 6	0.18	125	700	0.030	0.052	0.058	0.088	15	0 22½ 45	10 8 5	15 12 7	20 16 10
10 × 4, 8 × 5, 7 × 6	0.22	155						15	0 22½ 45	11 9 6	16 13 8	23 18 11
12 × 4, 10 × 5, 8 × 6	0.26	180						16	0 22½ 45	12 10 6	17 14 9	24 19 12
16 × 4, 12 × 5, 10 × 6	0.34	240						17	0 22½ 45	14 11 7	20 16 10	28 22 14
18 × 4, 14 × 5, 12 × 6	0.39	275						18	0 22½ 45	15 12 8	22 18 11	30 24 15
8 × 4, 7 × 5, 6 × 6	0.18	145	800	0.040	0.069	0.078	0.117	19	0 22½ 45	11 9 6	16 13 8	22 18 11
10 × 4, 8 × 5, 7 × 6	0.22	175						19	0 22½ 45	13 10 6	17 14 9	24 19 12
12 × 4, 10 × 5, 8 × 6	0.26	210						20	0 22½ 45	14 11 7	19 15 9	26 21 13
16 × 4	0.34	270						21	0	16	22	30

**Table 11-5 Performance Data for an Adjustable-Type, High Sidewall Diffuser (continued)**

Sizes, in.	$A_s$ , ft <sup>2</sup>	Flow, Rate, cfm	Veloc., ft/min	Veloc. Press., in. wg	Total Pressure, in. wg			NC	Defl., deg	Throw, ft		
					0°	22½°	45°			Min.	Mid.	Max.
10 × 4, 8 × 5, 7 × 6	0.22	220						25	0 22½ 45	16 13 8	19 15 10	27 22 13
12 × 4, 10 × 5, 8 × 6	0.26	260						26	0 22½ 45	17 14 8	21 17 11	19 23 15
16 × 4, 12 × 5, 10 × 6	0.34	340						27	0 22½ 45	20 16 10	24 19 12	33 26 17
18 × 4, 14 × 5, 12 × 6	0.39	390						28	0 22½ 45	21 17 11	26 21 13	36 29 18

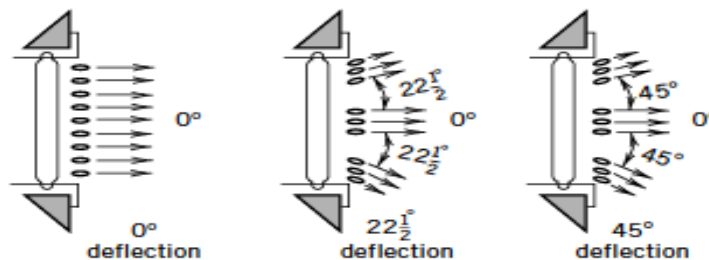

Source: Reprinted by permission of Environmental Elements Corporation, Dallas, TX.



**Example 2:** Suppose the room of Figure 1 is located in the southern latitudes where overhead systems are recommended. Select a round ceiling diffuser system and a high sidewall system. Also select a return grille.

Given: 250 cfm air quantity Required:

Select a round ceiling diffuser, select high sidewall grille, and select a return grille.

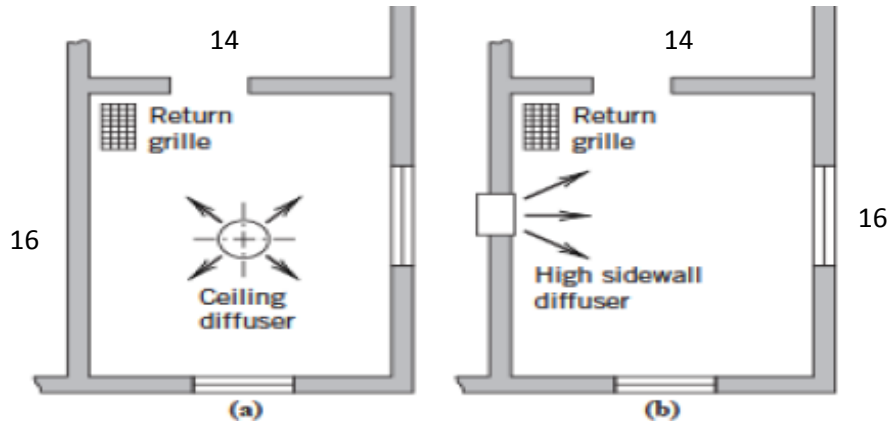


Figure 1

Solution: The data of Table 11.1 with information from Table 11.2 and 11.4 will be used to select a **ceiling diffuser**. The characteristic length is 7 or 8 ft and the throw-to-length ratio is 0.8; then

$$x_{50} / L = 0.8 \quad \rightarrow \quad x_{50} = 0.8 \times (7) = 5.6 \text{ ft}$$

Using correction factor:  $x_{50} = 5.6 / 0.75 = 7.5$

The best choice would be

Size, in	Throw, ft	NC	$\Delta P_o$ , in. wg
10	7 ½	10	0.035

The throw is larger than desired, but the throw-to-length ratio is within the range to give a minimum ADPI of 76 percent. **Figure 1a** shows this application.

A **high sidewall diffuser** may be selected from Table 11.2. In this case the throw-to-length ratio should be about 1.8 and the characteristic length is 14 ft; then

$$x_{50} / L = 1.8 \quad \rightarrow \quad x_{50} = 1.8 \times (14) = 25.2 \text{ ft}$$

At 240 cfm, pressure drop at 22 ½ degree spread would be 0.058:

At 250 cfm, pressure drop at 22 ½ degree spread would be acceptable

$$\Delta P = \left(\frac{250}{240}\right)^2 \times 0.058 = 0.063 \text{ in. wg}$$

The best choice would be

Size, in	Throw, ft	NC	$\Delta P_o$ , in. wg
16 x 4 12 x 5 10 x 6	25	18	0.063

## RETURN GRILLES

Velocities thru return grilles depend on (1) the static pressure loss allowed and (2) the effect on occupants or materials in the room. In determining the pressure loss, computations should be based on the free velocity thru the grille, not on the face velocity, since the orifice coefficient may approach 0.7. In general the following velocities may be used (see table 1-7):

**Table 1-7 Recommended return velocities for different applications.**

<b>GRILLE LOCATION</b>	<b>FPM OVER GROSS AREA</b>
<b>Commercial</b>	
Above occupied zone	800 and above
Within occupied zone not near seats	600-800
Within occupied zone near seats	400-600
Door or wall louvers	500-1000
Undercutting of doors	600*
<b>Industrial</b>	800 and above
<b>Residential</b>	400

\*Thru undercut area



Table 11.6 Performance Data for One Type of Return Grille


$A_g$ ft <sup>2</sup>	Sizes, in.	Core Velocity, fpm	200	300	400	500	600	700	800
			Velocity Pressure, in. wg	0.002	0.006	0.010	0.016	0.023	0.031
		Static Pressure, in. wg	-0.011	-0.033	-0.055	-0.088	-0.126	-0.170	-0.225
0.34	16 × 4	cfm	70	100	135	170	205	240	270
	10 × 6	NC <sup>a</sup>			13	20	25	30	33
0.39	18 × 4	cfm	80	115	155	195	235	275	310
	12 × 6	NC			14	21	26	31	34
0.46	20 × 4	cfm	90	140	185	230	275	320	370
	14 × 6	NC			15	22	27	32	35
	10 × 8								
0.52	24 × 4	cfm	105	155	210	260	310	365	415
	16 × 6	NC			16	23	28	33	36
0.60	28 × 4	cfm	120	180	240	300	360	420	480
	18 × 6	NC			17	24	29	34	37
0.69	12 × 8								
	30 × 4	cfm	140	205	275	345	415	485	550
	20 × 6	NC			17	24	29	34	37
0.81	14 × 8								
	12 × 10								
	36 × 4	cfm	160	245	325	405	485	565	650
	22 × 6	NC		10	18	25	30	35	38
0.90	16 × 8								
	14 × 10								
	40 × 4	cfm	180	270	360	450	540	630	720
	26 × 6	NC		11	19	26	31	36	39
	18 × 8								
1.07	16 × 10								
	12 × 12								
	48 × 4	cfm	215	320	430	535	640	750	855
	30 × 6	NC		12	20	27	32	37	40
1.18	18 × 10								
	14 × 12								
	34 × 6	cfm	235	355	470	590	710	825	945
	24 × 8	NC		13	21	28	33	38	41
1.34	20 × 10								
	16 × 12								
	60 × 4	cfm	270	400	535	670	805	940	1070
	36 × 6	NC		13	21	28	33	38	41
1.60	18 × 12								
	16 × 14								
	30 × 8	cfm	320	480	640	800	960	1120	1280
	24 × 10	NC		14	22	29	34	39	42
	22 × 12								
	18 × 14								

continues

**Table 11 .6** Performance Data for One Type of Return Grille (continued)

$A_g$ ft <sup>2</sup>	Sizes, in.	Core Velocity, fpm	Velocity Pressure, in. wg						
			200	300	400	500	600	700	800
		Static Pressure, in. wg	Core Velocity, fpm						
			200	300	400	500	600	700	800
1.80	48 × 6	cfm	360	540	720	900	1080	1260	1440
	36 × 12	NC		15	23	30	35	40	43
	30 × 10								
	24 × 12								
2.08	60 × 6	cfm	415	625	830	1040	1250	1460	1660
	40 × 8	NC		16	24	31	36	41	44
	36 × 10								
	30 × 12								
2.45	48 × 8	cfm	490	735	980	1220	1470	1720	1960
	26 × 14	NC		17	25	32	37	42	45
	24 × 16								
	20 × 16								
2.78	36 × 12	cfm	555	835	1110	1390	1670	1950	2220
	30 × 14	NC		18	26	33	38	43	46
	26 × 16								
	24 × 18								
3.11	40 × 12	cfm	620	935	1240	1560	1870	2180	2490
	36 × 14	NC		19	27	34	39	44	47
	30 × 16								
	24 × 20								
3.61	48 × 12	cfm	720	1080	1440	1800	2170	2530	2890
	36 × 16	NC		20	28	35	40	45	48
	24 × 24								

\*Based on a room absorption of 8 dB, with respect to 10<sup>-12</sup> watts, and one return.

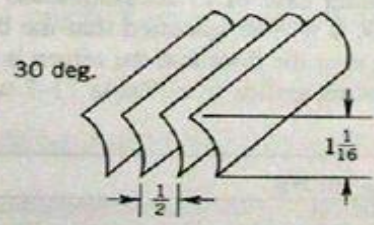

Source: Reprinted by permission of Environmental Elements Corporation, Dallas, TX.



Example: Small store dimensions: 32 × 23 × 16 ft

Ceiling – flat

Load – equally distributed

Air quantity – 2000 cfm

Temp difference – 25 F

**Find:** Number of outlets, Size of outlets,

Solution:

-The minimum blow is 75% of the room width for the given condition of equally distributed heat load. Therefore, the minimum blow necessary is:  $23 \times 0.75 = 17.3$  ft

- The maximum blow is the width of the room = 32 ft

- The blow of 17.5 to 34 ft.

- No. of outlets =  $\frac{2000}{500} = 4$

- nominal size 24 in. x 6 in

$k = \frac{2000}{32 \times 16} = 3.9$

**TABLE 1-8 – WALL OUTLET RATINGS, FOR COOLING ONLY**

For Flat Ceilings

OUTLET VELOCITY		250 FPM						375 FPM						500 FPM						750 FPM						
STATIC PRESSURE STANDARD OUTLET		Ser B = .01, 22 1/2" = .01 45" = .01						Ser B = .013, 22 1/2" = .015 45" = .019						Ser B = .024, 22 1/2" = .028 45" = .035						Ser B = .051, 22 1/2" = .061 45" = .08						
STATIC PRESSURE WITH METERING PLATE		Ser B = .01, 22 1/2" = .015 45" = .028						Ser B = .024, 22 1/2" = .043 45" = .085						Ser B = .061, 22 1/2" = .082 45" = .118						Ser B = .175, 22 1/2" = .19 45" = .27						
Nom. Size of Outlet (and Free Area)	Vane Setting	Air Quantity (cfm)	Blow (ft)	Temp Diff (F)				Air Quantity (cfm)	Blow (ft)	Temp Diff (F)				Air Quantity (cfm)	Blow (ft)	Temp Diff (F)				Air Quantity (cfm)	Blow (ft)	Temp Diff (F)				
				15	20	25	15			20	25	15	20			25	15	20	25							
				Min Clg Hr						Min Clg Hr						Min Clg Hr						Min Clg Hr				
8 x 4 (16.9)	Straight 22 1/2" 45"	36	3.5	6.5	7.0	7.0	44	7.0	7.5	7.5	8.0	59	10.0	7.5	8.0	8.5	89	17.0	8.5	9.0	9.0					
				2.5	6.5	6.5			6.5	5.1	6.5			7.0	7.0	7.5			7.0	7.5	7.5	8.0	13.0	7.5	7.5	8.0
				1.8	6.0	6.0			6.5	3.5	6.5			6.5	7.0	5.0			6.5	6.5	7.0	9.0	6.5	7.0	7.0	
10 x 4 (21.7)	Straight 22 1/2" 45"	37	3.5	6.5	7.0	7.5	57	7.4	7.5	7.5	8.0	75	10.3	7.5	8.0	8.5	112	18.0	8.5	9.0	9.0					
				2.5	6.5	6.5			7.0	5.5	6.5			7.0	7.0	8.0			7.0	7.5	7.5	8.0	13.0	7.5	8.0	8.0
				1.8	6.0	6.0			6.5	3.7	6.5			6.5	7.0	3.4			6.5	6.5	7.0	9.0	6.5	7.0	7.0	
12 x 4 (24.6)	Straight 22 1/2" 45"	44	3.5	6.5	7.0	7.5	64	7.5	7.5	7.5	8.0	91	11.0	8.0	8.0	8.5	136	18.0	8.5	9.0	9.5					
				2.5	6.5	6.5			7.0	5.5	7.0			7.0	7.5	8.1			7.0	7.5	7.5	13.0	7.5	8.0	8.5	
				1.8	6.0	6.5			6.5	3.9	6.5			6.5	7.0	5.5			6.5	7.0	7.0	9.0	6.5	7.0	7.0	
14 x 4 (33.9)	Straight 22 1/2" 45"	61	3.7	7.0	7.0	7.5	92	7.9	7.5	7.5	8.0	133	11.0	8.0	8.0	8.5	183	19.0	8.5	9.0	9.5					
				2.7	6.5	6.5			7.0	6.0	7.0			7.0	7.5	8.1			7.0	7.5	7.5	14.0	7.5	8.0	8.5	
				2.0	6.0	6.5			6.5	4.0	6.5			6.5	7.0	5.5			6.5	7.0	7.0	10.0	6.5	7.0	7.5	
20 x 4 (45.2)	Straight 22 1/2" 45"	77	4.0	7.0	7.0	7.5	115	8.0	7.5	8.0	8.0	154	11.5	8.0	8.0	8.5	231	20.0	8.5	9.0	9.5					
				3.0	6.5	6.5			7.0	6.0	7.0			7.0	7.5	8.5			7.5	7.5	8.0	15.0	7.5	8.0	8.5	
				2.0	6.0	6.5			6.5	4.0	6.5			6.5	7.0	6.0			6.5	7.0	7.0	10.0	6.5	7.0	7.5	
24 x 4 (53.0)	Straight 22 1/2" 45"	93	4.1	7.0	7.0	7.5	139	8.0	7.5	8.0	8.0	185	11.5	8.0	8.0	8.5	278	20.0	8.5	9.0	10.0					
				3.1	6.5	7.0			7.0	6.0	7.0			7.0	7.5	8.5			7.5	8.0	15.0	7.5	8.0	8.5		
				2.0	6.0	6.5			6.5	4.0	6.5			6.5	7.0	6.0			6.5	7.0	7.0	10.0	6.5	7.0	7.5	
30 x 4 (64.3)	Straight 22 1/2" 45"	114	4.2	7.0	7.0	7.5	175	8.0	7.5	8.0	8.0	233	12.0	8.0	8.0	8.5	349	21.0	8.5	9.5	10.0					
				3.1	6.5	7.0			7.0	6.0	7.0			7.5	7.5	9.0			7.5	8.0	16.0	7.5	8.0	8.5		
				2.1	6.0	6.5			6.5	4.0	6.5			6.5	7.0	6.0			6.5	7.0	7.0	11.0	7.0	7.0	7.5	
36 x 4 (83.3)	Straight 22 1/2" 45"	140	4.4	7.0	7.5	7.5	210	8.0	7.5	8.0	8.0	279	13.0	8.0	8.5	9.0	420	21.0	9.0	9.5	10.0					
				3.3	6.5	7.0			7.0	6.0	7.0			7.5	7.5	9.0			7.5	8.0	16.0	7.5	8.5	8.5		
				2.2	6.0	6.5			6.5	4.0	6.5			6.5	7.0	6.0			6.5	7.0	7.0	11.0	7.0	7.0	7.5	
8 x 6 (24.3)	Straight 22 1/2" 45"	52	5.0	7.5	7.5	8.0	77	9.5	8.0	8.0	8.5	103	13.0	8.5	9.0	9.0	153	24.0	8.5	10.0	10.5					
				3.8	7.0	7.0			7.5	7.0	7.0			7.5	8.0	10.0			7.5	8.0	8.5	18.0	8.0	8.5	9.5	
				2.5	6.0	6.5			6.5	4.8	6.5			7.0	7.0	6.0			7.0	7.0	7.5	12.0	7.0	7.5	8.0	
10 x 6 (34.0)	Straight 22 1/2" 45"	64	5.5	7.5	8.0	8.0	98	10.0	8.0	8.5	9.0	131	15.0	9.0	9.5	10.0	194	27.0	10.0	10.5	11.5					
				4.1	7.0	7.5			7.5	7.5	7.5			8.0	8.5	11.0			8.0	8.5	9.0	20.0	8.5	9.0	10.0	
				2.8	6.5	7.0			7.0	5.0	7.0			7.0	7.5	7.0			7.0	7.5	7.5	14.0	7.5	7.5	8.0	
12 x 6 (41.4)	Straight 22 1/2" 45"	80	6.0	7.5	8.0	8.5	119	11.0	8.0	9.0	9.5	159	15.0	9.0	9.5	10.0	238	28.0	10.0	11.0	11.5					
				4.5	7.0	7.5			7.5	8.1	7.5			8.0	8.5	11.0			8.0	8.5	9.0	21.0	9.0	9.5	10.0	
				3.0	6.5	7.0			7.0	5.5	7.0			7.0	7.5	7.0			7.0	7.5	7.5	14.0	7.5	8.0	8.0	
14 x 6 (54.4)	Straight 22 1/2" 45"	107	6.2	8.0	8.0	8.5	161	12.0	8.5	9.0	9.5	214	16.0	9.5	10.0	10.5	321	30.0	11.0	11.5	12.5					
				4.7	7.0	7.5			7.5	9.0	8.0			8.0	8.5	12.0			8.5	9.0	9.5	23.0	9.5	10.0	10.5	
				3.2	6.5	7.0			7.0	6.0	7.0			7.0	7.5	8.0			7.5	7.5	8.0	15.0	7.5	8.0	8.5	
20 x 6 (71.3)	Straight 22 1/2" 45"	135	6.6	8.0	8.5	9.0	202	12.0	9.0	9.5	10.0	269	17.0	9.5	10.0	11.0	403	32.0	11.5	12.0	13.0					
				5.0	7.5	7.5			8.0	9.0	8.0			8.5	9.0	13.0			8.5	9.0	9.5	24.0	9.5	10.0	11.0	
				3.2	7.0	7.0			7.5	6.6	7.0			7.5	7.5	9.0			7.5	8.0	8.0	16.0	8.0	8.5	9.0	
24 x 6 (84.3)	Straight 22 1/2" 45"	163	7.0	8.0	8.5	9.0	243	13.0	9.0	9.5	10.0	324	18.0	10.0	10.5	11.0	484	33.0	12.0	12.5	13.0					
				5.1	7.5	8.0			8.0	10.0	8.0			8.5	9.0	13.0			8.5	9.0	10.0	25.0	10.0	10.5	11.0	
				3.5	7.0	7.0			7.5	6.5	7.0			7.5	8.0	9.0			7.5	8.0	8.5	17.0	8.0	8.5	9.1	
30 x 6 (109.0)	Straight 22 1/2" 45"	203	7.0	8.5	8.5	9.5	304	13.0	9.0	10.0	10.5	406	19.0	10.0	11.0	11.5	609	34.0	12.0	12.5	13.5					
				5.4	7.5	8.0			8.0	10.0	8.0			9.0	9.0	14.0			9.0	9.5	10.0	25.0	10.0	10.5	11.5	
				3.5	7.0	7.0			7.5	6.5	7.5			7.5	8.0	10.0			7.5	8.0	8.5	17.0	8.0	9.0	9.0	
36 x 6 (131.3)	Straight 22 1/2" 45"	245	7.1	8.5	9.0	9.5	366	13.0	9.5	10.0	10.5	490	19.0	10.0	11.0	12.0	735	35.0	12.0	13.0	14.0					
				5.5	7.5	8.0			8.5	10.0	8.5			9.0	9.5	14.0			9.0	9.5	10.0	26.0	10.0	10.5	11.5	
				3.5	7.0	7.5			7.5	6.5	7.5			8.0	8.0	10.0			8.0	8.0	8.5	18.0	8.5	9.0	9.5	

K FACTOR								
Max Cfms/Sq Ft Outlet Wall Area	29.0		19.0		14.0		9.6	
Min Cfms/Sq Ft Outlet Wall Area	8.7		5.7		4.2		2.9	