



# Chapter one: Introductory Concepts

*Fall Semester 2023*

*Chemical Engineering and Petroleum Industries  
Al-Mustaqbal University College*



*Prepared by*  
**Dr. Abbas J. Sultan**



## The objectives of Chapter One (Introductory Concepts)

In this chapter, we examine the concept of chemical process control and introduce several examples to illustrate the necessity for process modeling as we begin our study of process dynamics and control.



## Why Process Control?

As competition becomes stiffer in the chemical marketplace and processes become more complicated to operate, it is advantageous to make use of some form of automatic control.

Automatic control of a process offers many advantages, including

1. Enhanced process safety.
2. Satisfying environmental constraints.
3. Meeting ever-stricter product quality specifications.
4. More efficient use of raw materials and energy.
5. Increased profitability.

✓ Considering all the benefits that can be realized through process control, it is well worth the time and effort required to become familiar with the concepts and practices used in the field.



## Control Systems

Control systems are used to maintain process conditions at their desired values by manipulating certain process variables to adjust the variables of interest.



# Common examples of a control system from everyday life

## Example#1: Cruise control on an automobile


The purpose of cruise control is to maintain the speed of the vehicle (the **controlled variable**) at the desired value (the **setpoint**) despite variations in terrain, hills, etc. (**disturbances**) by adjusting the throttle or the fuel flow to the engine (the **manipulated variable**).



## Control Systems

### Example#2: Control system on the hot water heater

The control system on the hot water heater attempts to maintain the temperature in the tank at the desired value by manipulating the fuel flow to the burner (for a gas heater) or the electrical input to the heater in the face of disturbances such as the varying demand on the heater early in the morning, as it is called upon to provide water for the daily showers.

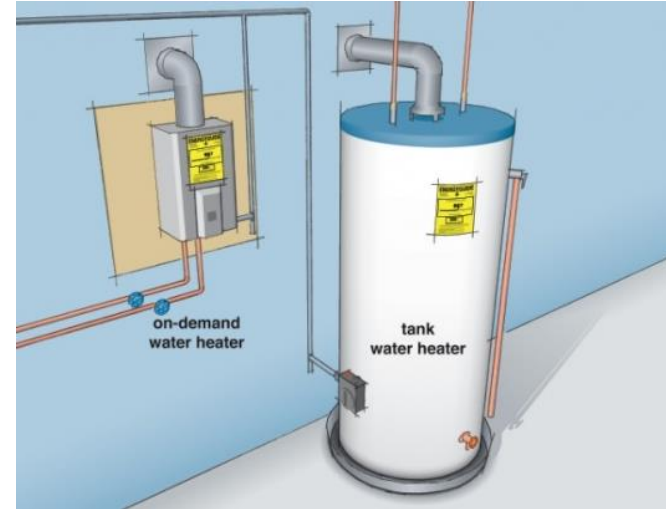



# Control Systems

## Example#3: Home Thermostat

➤ This control system is designed to maintain the temperature in the home at a comfortable value by manipulating the fuel flow or electrical input to the furnace. The furnace control system must deal with a variety of disturbances to maintain the temperature in the house, such as heat losses, doors being opened and hopefully closed, and leaky inefficient windows.

✓ The furnace must also be able to respond to a request to raise the desired temperature if necessary. For example, we might desire to raise the temperature by 5, and we'd like the system to respond smoothly and efficiently.



## What do we conclude from these examples?

Based on the provided examples, it can be observed that control systems possess some common features.


1. The ability to maintain the process variable at its desired value despite disturbances might be experienced (this is termed **disturbance rejection**).
2. The ability to move the process variable from one setting to a new desired setting (this is termed **set point tracking**).





## The generalized process control system


Conceptually we can view the control systems we've discussed in the following general manner ( Figure1).

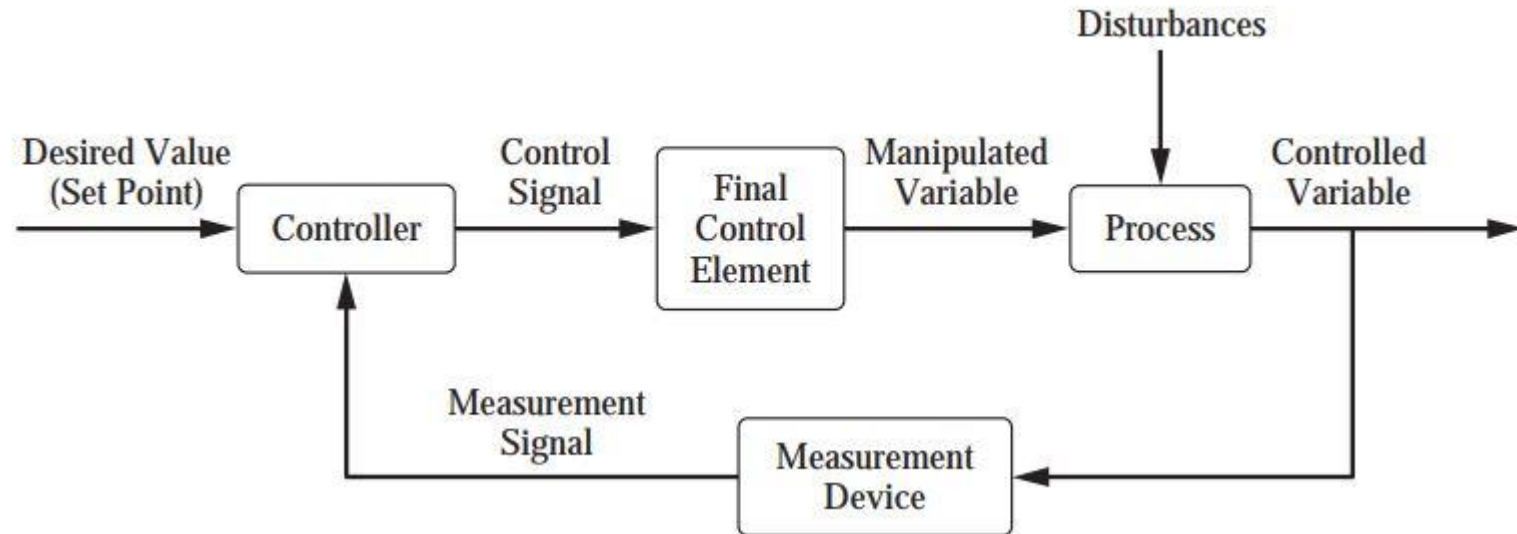

The controller compares the **measurement signal of the controlled variable** to the **set point (the desired value of the controlled variable)**. The difference between the two values is called the error.

$$\text{Error} = (\text{Set point value}) - (\text{Measurement signal of controlled variable})$$

## The generalized process control system

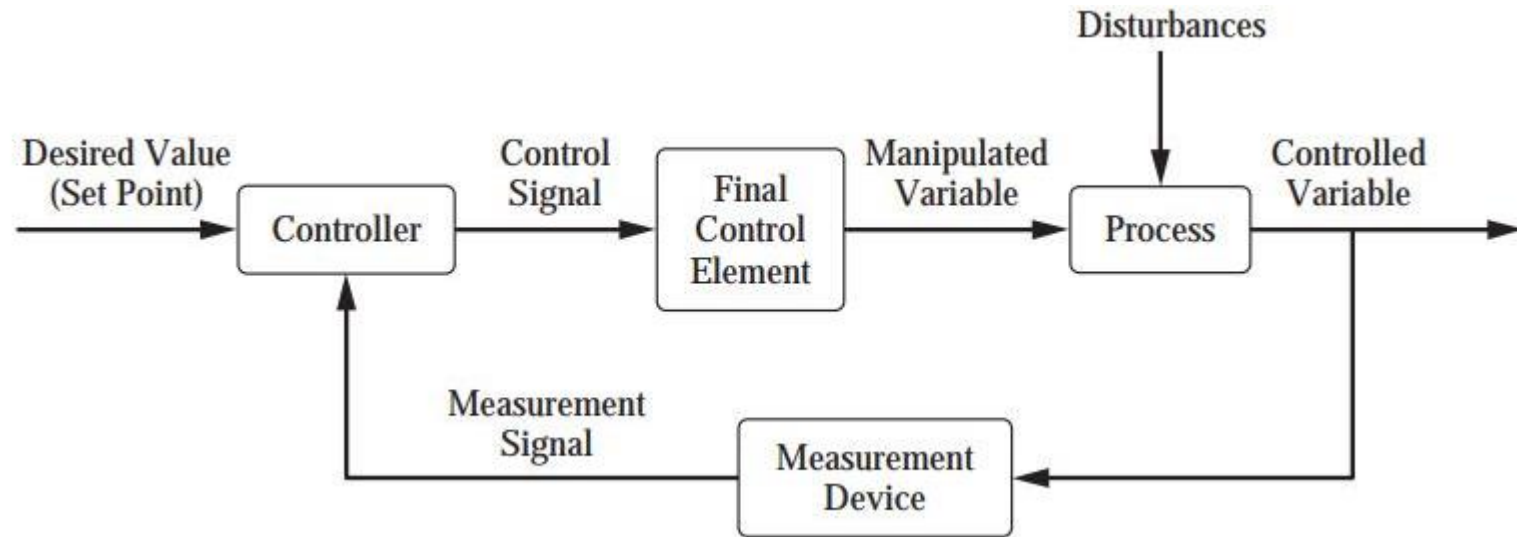

- Depending upon the magnitude and sign of the error, the controller takes appropriate action by sending a signal to the final control element, which provides an input to the process to return the **controlled variable** to the **set point**.
- The concept of using information about the deviation of the system from its desired state to control the system is called **feedback control**. Information about the state of the system is “fed back” to a controller, which utilizes this information to change the system in some way.<sup>10</sup>


## Types of Control System

### 1. Closed-loop system

Closed-loop refers to the fact that the controller automatically acts to return the controlled variable to its desired value.

- Dependent on output
- Feedback is present


Consists of : (1) Controller (2) Process (3) Feedback system (4) Error detector or comparator

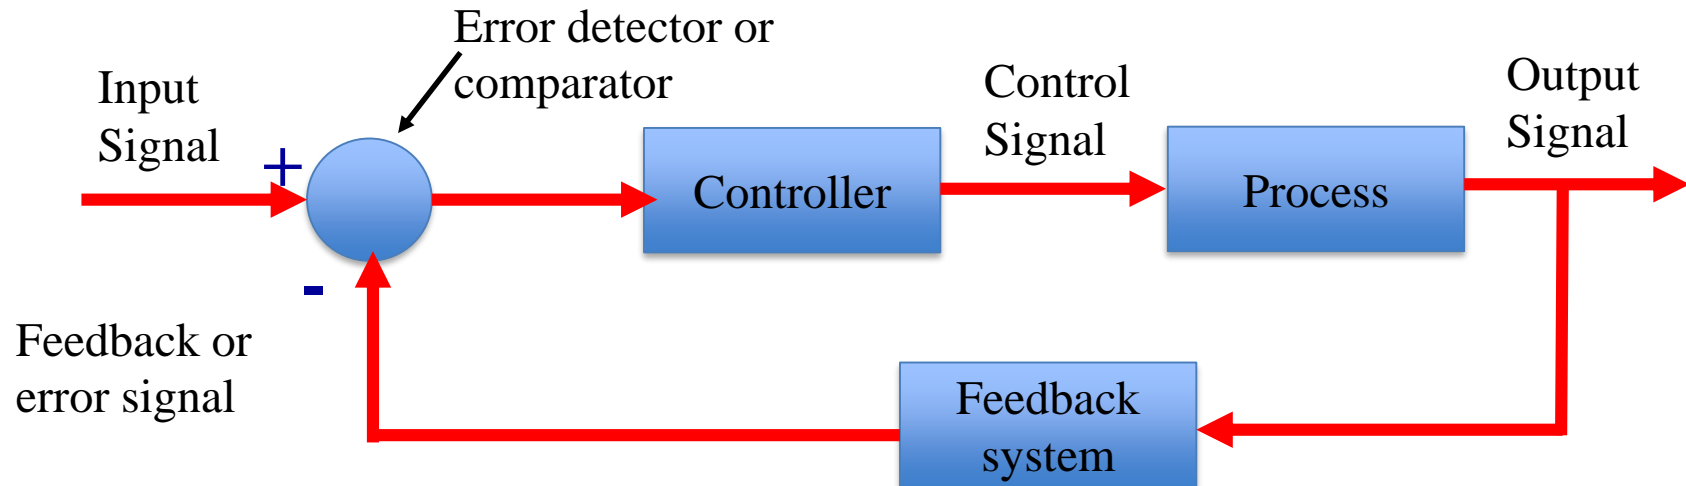



## Example of a closed-loop system

Closed-Loop Control Systems utilizes feedback to compare the actual output to the desired output response.

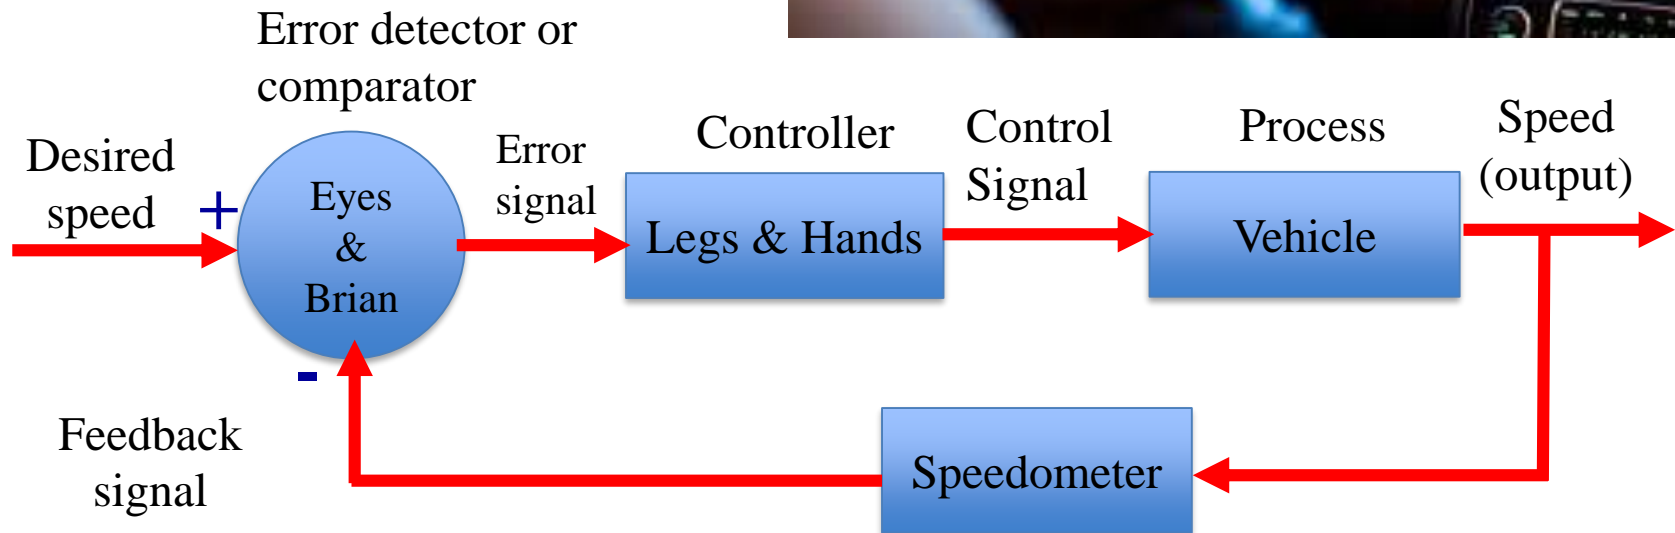

## Advantages and Disadvantages of the closed-loop system

Advantages	Disadvantages
It is an accurate and reliable system.	It is complicated to design.
It is faster.	It is costly.
It reduces the effect of parameter variation.	It can become unstable under certain conditions.
Automatic mode	


**Note:** Closed loop system which is also named as automatic control system.

## 2. Open-loop system

- Controlling action are independent of the output of system.
- No Feedback.

### Structure



- Two components
  - 1) Controller
  - 2) process

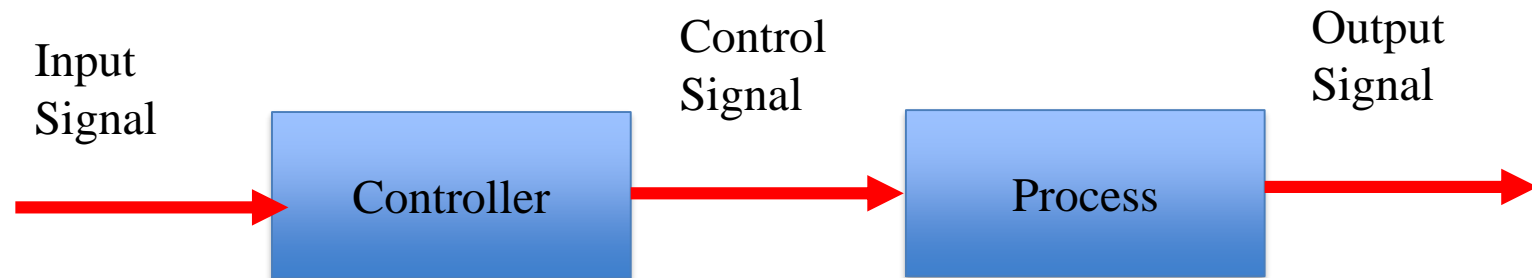

**Note:** Open loop system which is also called as Manual control system.




## Example of an open-loop system

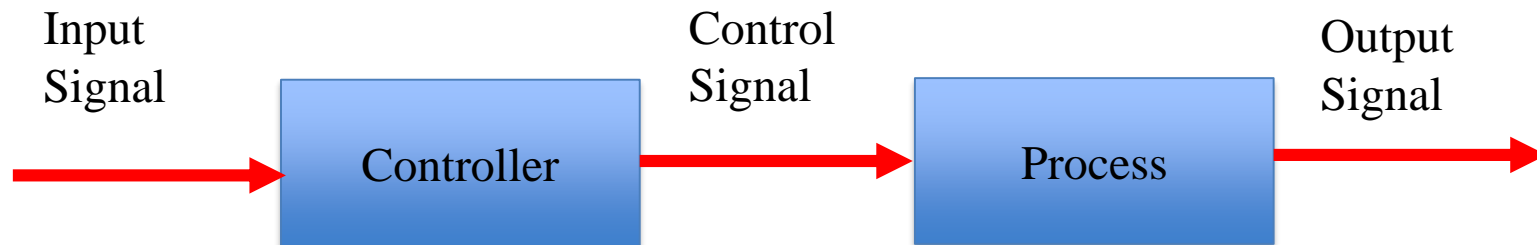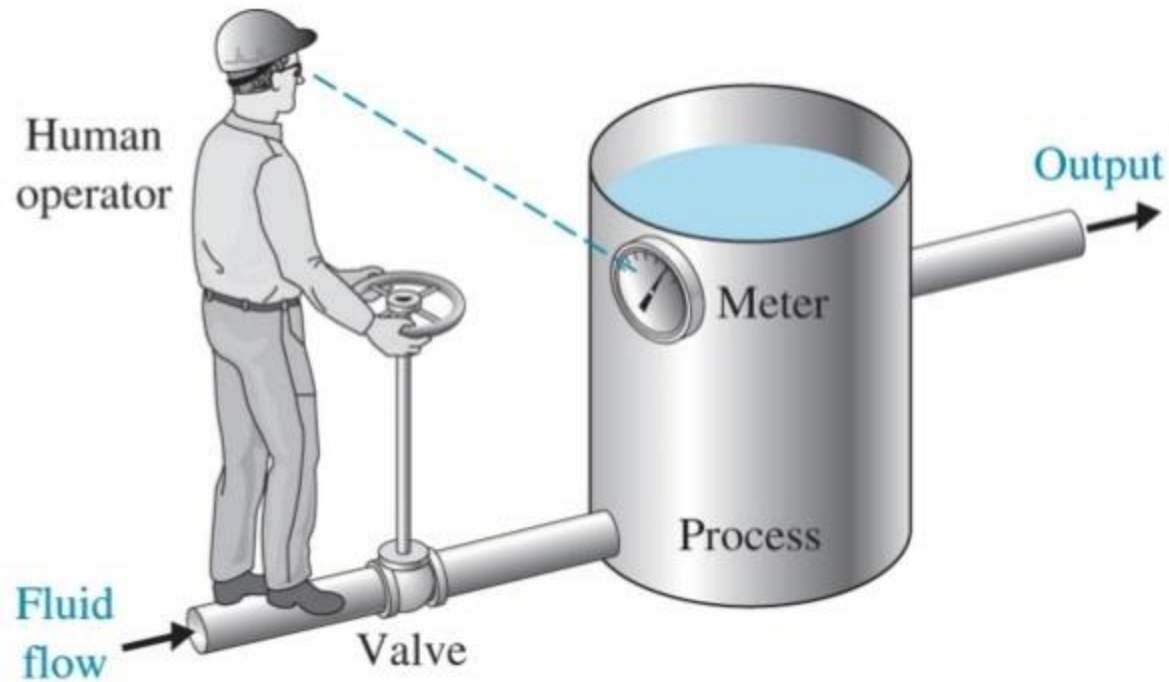

## Advantages and Disadvantages of the open-loop system

Advantages	Disadvantages
Simple to design.	Inaccurate
Less maintenance is required.	Internal noise and parameter variation affect system performance.
	Not reliable.
	Manual mode control

## Closed-loop system

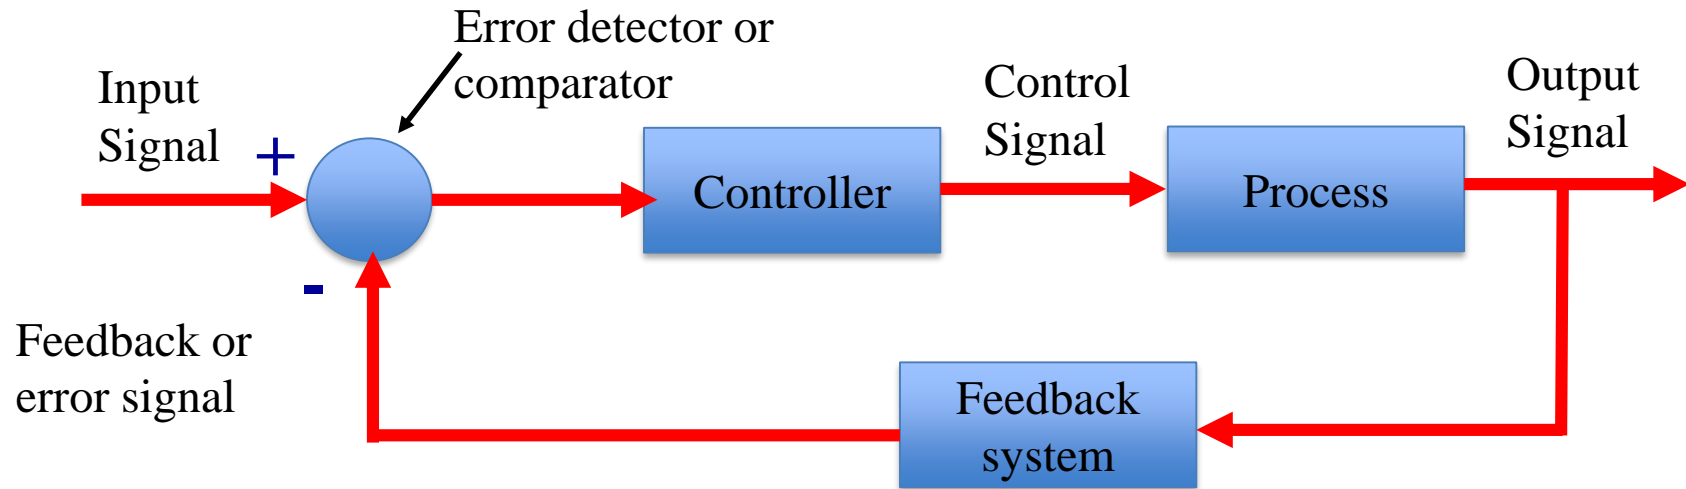

$$\text{Error} = (\text{Set point value}) - (\text{Measurement signal of controlled variable})$$

Negative feedback is the most common type of signal feedback. Negative refers to the fact that the error signal is computed from the difference between the set point and the measured signal. The negative value of the measured signal is “fed back” to the controller and added to the set point to compute the error.




**Example 1.1: Hot water tank control system.** As a specific example, let us consider a hot water heater for the home and examine its control system, using the same type of diagram. The desired hot water temperature is selected by the homeowner, and typically it is in the neighborhood of 50 °C to 60 °C. Let us assume that the **set point is 55 °C**. Explain how does this control system work.

- The thermocouple measures the water temperature in the tank and sends a signal to the thermostat, indicating the temperature. The thermostat (controller) determines the error as:



$$\text{Error} = T_{\text{set point}} - T_{\text{measured}}$$

- If the error is positive ( $> 0$ ), the measured temperature is lower than desired, and the thermostat opens the fuel valve to the burner, which adds heat to the tank.

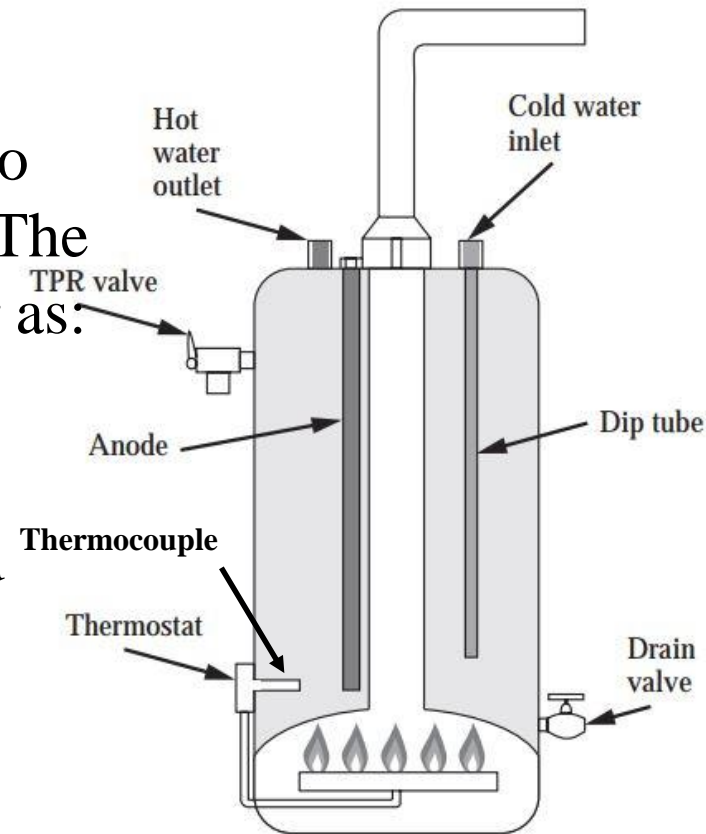

## Example 1.1: Hot water tank control system.

- If the error is zero or negative ( $\leq 0$ ), the thermostat closes the fuel valve, and no heat is added to the tank.
- Disturbances to the system, which decrease the temperature of the water in the tank, include ambient heat losses and hot water demand by the household, which is replaced with a cold-water feed.

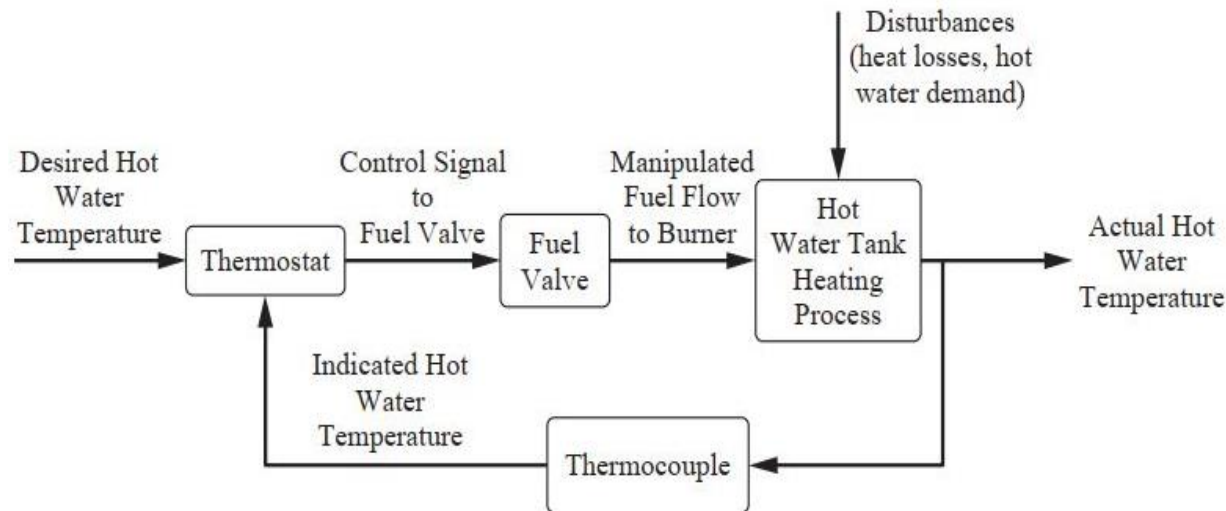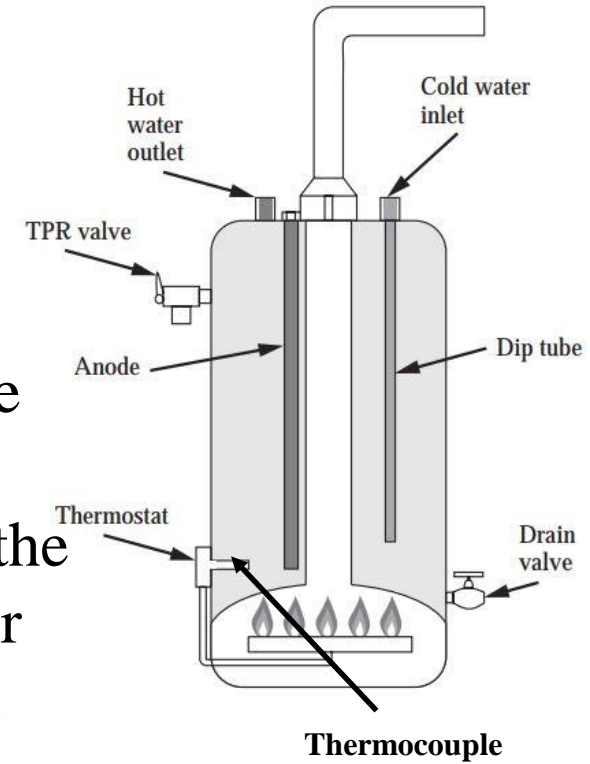


Block diagram of a hot water heater control system.

# Types of Controllers

## 1. “on/off” type of controller

- The thermostat on the hot water heater is called an “on/off” type of controller. Depending on the value of the error signal, the output from the controller is either “full-on” or “full off” and the fuel valve is fully open or fully closed; there are no intermediate values of the output.
- Many other types of controllers that we will study can modulate their output based on the magnitude of the error signal, how long the error signal has persisted, and even how rapidly the error appears to be changing.

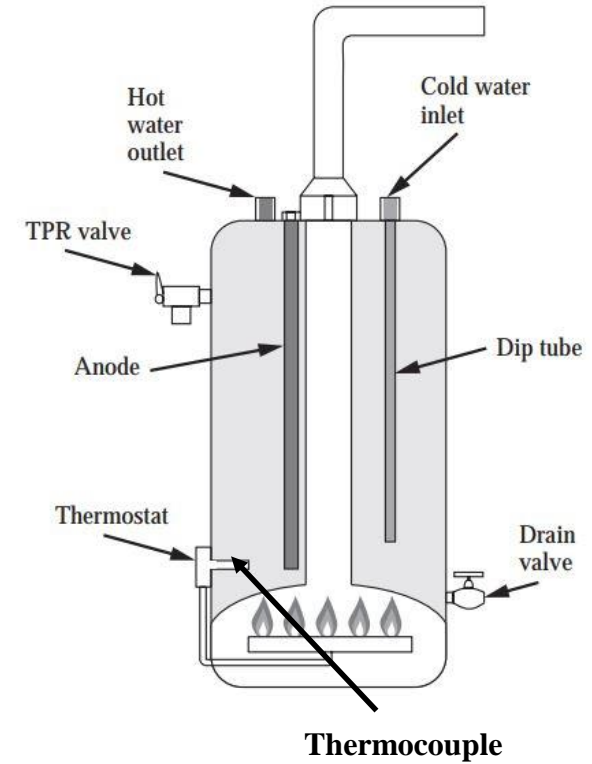

## 2. Proportional Control

- Clearly, the larger the error, the less we are satisfied with the present state of affairs and vice versa. In fact, we are completely satisfied only when the error is exactly zero. Based on these considerations, it is natural to suggest that the controller should change the heat input by an amount proportional to the error. This is called proportional control.
- In effect, the controller is instructed to maintain the heat input at the steady-state design value as long as the error is zero.
- If the tank temperature deviates from the set point, causing an error, the controller is to use the magnitude of the error to change the heat input proportionally.

## 2. Proportional Control

- We shall reserve the right to vary the proportionality constant to suit our needs. This degree of freedom forms a part of our instructions to the controller.
- As we will see shortly during the course of our studies, the larger we make the proportionality constant for the proportional controller (called the controller gain), the smaller the steady-state error will become.
- We will also see that it is impossible to completely eliminate the error through the use of a proportional controller.



## Why is it impossible to eliminate the error using a proportional controller?


- For example, if the set point is  $55\text{ }^{\circ}\text{C}$  and a disturbance occurs that drops the temperature to  $50\text{ }^{\circ}\text{C}$ , if we use only a proportional controller, then we will never be able to get the tank temperature to exactly  $55\text{ }^{\circ}\text{C}$ . Once the system stabilizes again, the temperature will not be exactly  $55\text{ }^{\circ}\text{C}$ , but perhaps  $53\text{ }^{\circ}\text{C}$  or  $56\text{ }^{\circ}\text{C}$ . There will always be some residual steady state error (called **offset**).
- For a home water heater, this is probably good enough; the exact temperature is not that critical. In an industrial process, this may not be adequate, and we have to resort to a bit more complicated controller to drive the error to zero.

### 3. Integral controller

- Considerable improvement may be obtained over proportional control by adding integral control.
- The controller is now instructed to change the heat input by an additional amount proportional to the time integral of the error. This type of control system has two adjustable parameters: a multiplier for the error and a multiplier for the integral of the error. If this type of controller is used, the steady-state error will be zero.
- From this standpoint, the response is clearly superior to that of the system with proportional control only.
- One price we pay for this improvement is the tendency for the system to be more oscillatory. The system will tend to overshoot its final steady-state value before slowly settling out at the desired set point. So, what is the best control system to use for a particular application? This and related questions will be addressed in subsequent chapters.


## Block Diagram

- A good overall picture of the relationships among variables in the heated-tank control system may be obtained by preparing a block diagram.
- It indicates the flow of information around the control system and the function of each part of the system.
- Much more will be said about block diagrams later, but the reader can undoubtedly form a good intuitive notion about them by comparing the below figure with the physical description of the process.

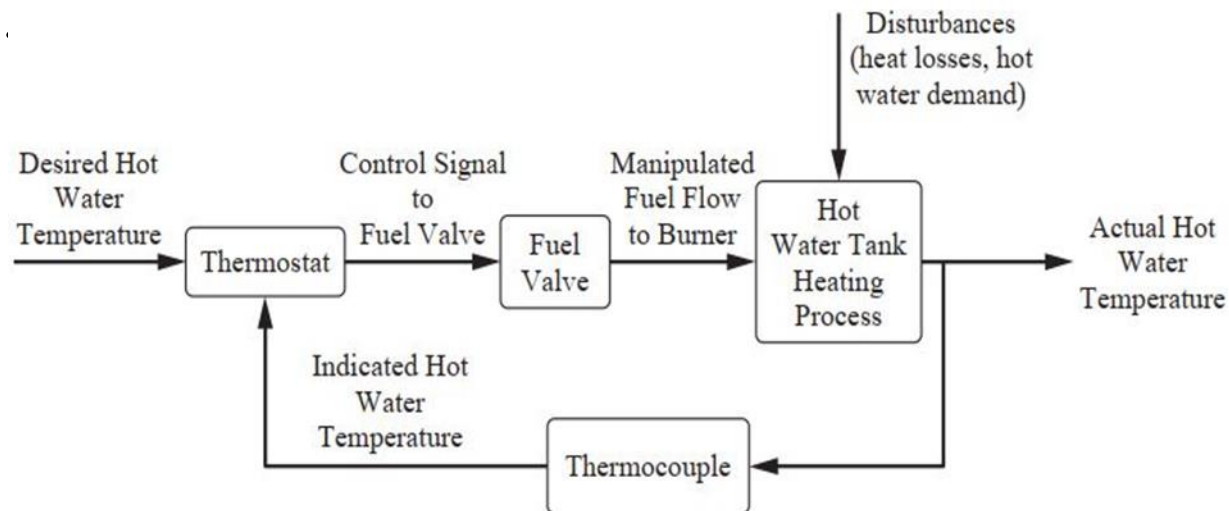

## Block Diagram

- Particularly significant is the fact that each component of the system is represented by a block, with little regard for the actual physical characteristics of the represented component (e.g., the tank or controller).
- The major interest is in (1) the relationship between the signals entering and leaving the block and (2) the manner in which information flows around the system.

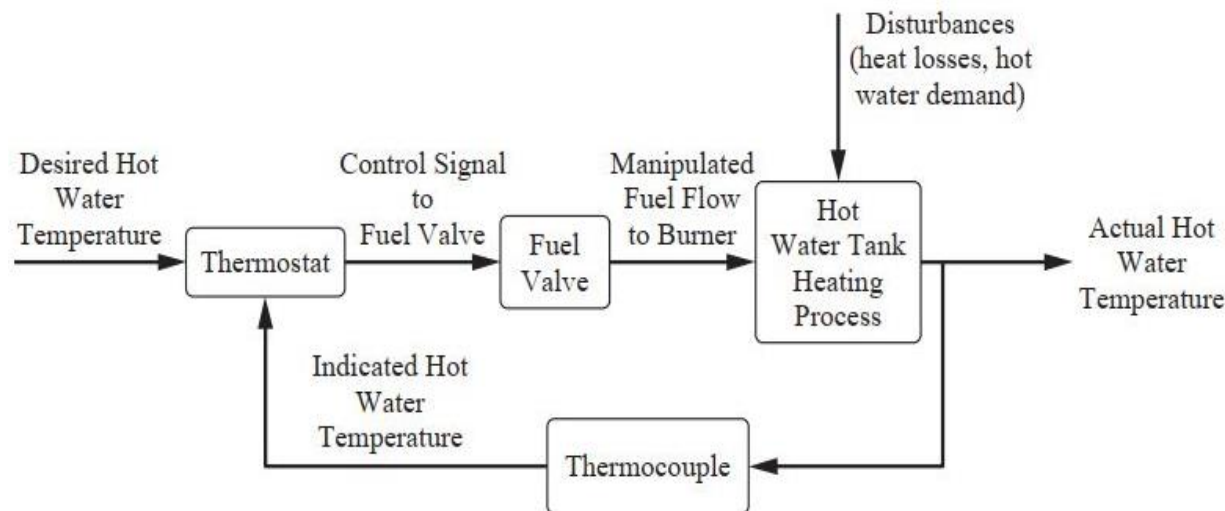

## Summary of chapter one

1. **Block diagram:** Diagram that indicates the flow of information around the control system and the function of each part of the system.
2. **Closed-loop:** In a closed-loop, the measured value of the controlled variable is fed back to the controller.
3. **Controlled variable:** The process variable that we want to maintain at a particular value.
4. **Controller:** A device that outputs a signal to the process based on the magnitude of the error signal. A proportional controller outputs a signal proportional to the error.



## Summary of chapter one

5. Disturbance rejection: One goal of a control system, which is to enable the system to “reject” the effect of disturbance changes and maintain the controlled variable at the set point.
6. Disturbances: Any process variables that can cause the controlled variable to change. In general, disturbances are variables that we have no control over.
7. Error: The difference between the values of the set point and the measured variable.
8. Manipulated variable: Process variable that is adjusted to bring the controlled variable back to the set point.

## Summary of chapter one

9. Negative feedback: In negative feedback, the error is the difference between the set point and the measured variable (this is usually the desired configuration).
10. Offset : The steady-state value of the error.
11. Open loop: In an open loop, the measured value of the controlled variable is not fed back to the controller.
12. Positive feedback: In positive feedback, the measured temperature is added to the set point. (This is usually an undesirable situation and frequently leads to instability.)
13. Set point: The desired value of the controlled variable.
14. Set point tracking: One goal of a control system, which is to force the system to follow or “track” requested set point changes.

*Thank  
you*

